

Preventative Maintenance Kits & Spare Parts



972 Centerville Road,
Pulaski, New York 13142
(315) 298-5121

VSRT-250 VERTICAL SPIRAL RIB TUBELESS STEAM BOILERS

VSRT




A consistent preventative maintenance routine is an important part of continuing efficient and reliable operation of your steam boiler system. This bulletin details the recommended parts to perform an annual PM of your Fulton boiler(s) along with suggested spare parts to have on hand if the need arises.

Preventative Maintenance of your Fulton boiler should be performed by a factory authorized Service Technician in accordance with the Installation, Operation and Maintenance Manual.

PREVENTATIVE MAINTENANCE KIT	PART #
VSRT-250 PM Kit	4-50-VSRT250
KIT INCLUDES:	
Air Media Filter - Qty 2	2-12-000209
Handhole Gasket - Qty 5	2-12-000197
Water Level Probe	2-20-000009
O2 Sensor	2-45-315551
Burner Plate Gasket	2-12-292508
Gauge Glass 10 ⁵ / ₈ "	2-12-000066
Gauge Glass Gasket - Qty 2	2-12-100001
O-Ring 1 ⁵ / ₈ "	2-12-000721

Spare parts listed on next page.

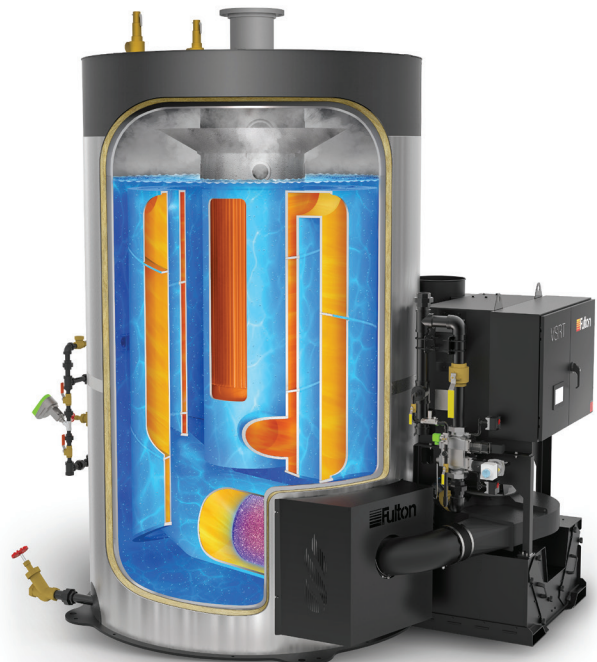

VSRT

SPARE PARTS	PART #
Chain Operated Valve Set for MM Control	2-30-100255
10 ⁵ / ₈ " Gauge Glass for MM Control	2-12-000066
Combustion Air Pressure Switch	2-30-005098
Air Filter Switch	2-30-001266
Ignition Transformer	2-40-000082
UV Scanner	2-40-001107
RTD Sensor for Boiler Water Temperature	2-40-000838
PT100 Sensor for Inlet Air Temperature	2-50-315301
Pilot Solenoid Valve	2-30-000298
Pilot Gas Regulator	2-30-004022
High Gas Pressure Switch	2-40-000390
Low Gas Pressure Switch	2-40-000387
Main Gas Valve	2-40-001044
SKP25 Gas Valve Actuator	2-40-000884
LMV 36 Base	2-40-000476
Safety Valve 150psi	2-30-000085
Gas Servo	2-40-001186
Air Servo	2-40-000472
24 VDC Slimline Relay	2-45-315011
120 V Slimline Relay	2-45-001235
Speed Sensor	2-40-002100
Burner Gasket (Burner Replacement Only)	2-12-292509
Burner	2-30-292500



972 Centerville Road
Pulaski, New York 13142
(315) 298-5121



Find your solution at:
www.fulton.com

FSS-VSRT-250-PM-KIT-220805